


LIFE SAFETY LEGEND	
4 Hour Fire Barrier	4HR
3 Hour Fire Barrier	3HR
2 Hour Fire Barrier	2HR
1 Hour Fire Barrier	1HR
Smoke Barrier	SMK
Smoke Resistive Partition	STP
Exit Stairwell	
Exit Passageway	
Exit Access Corridor	
Suite (Color May Vary)	
Area Under Construction	
Deficiency Identifier	LAA DEFICIENCY CODE
Hazardous Area	
Exterior Exit	
Trash/Linen Chute	

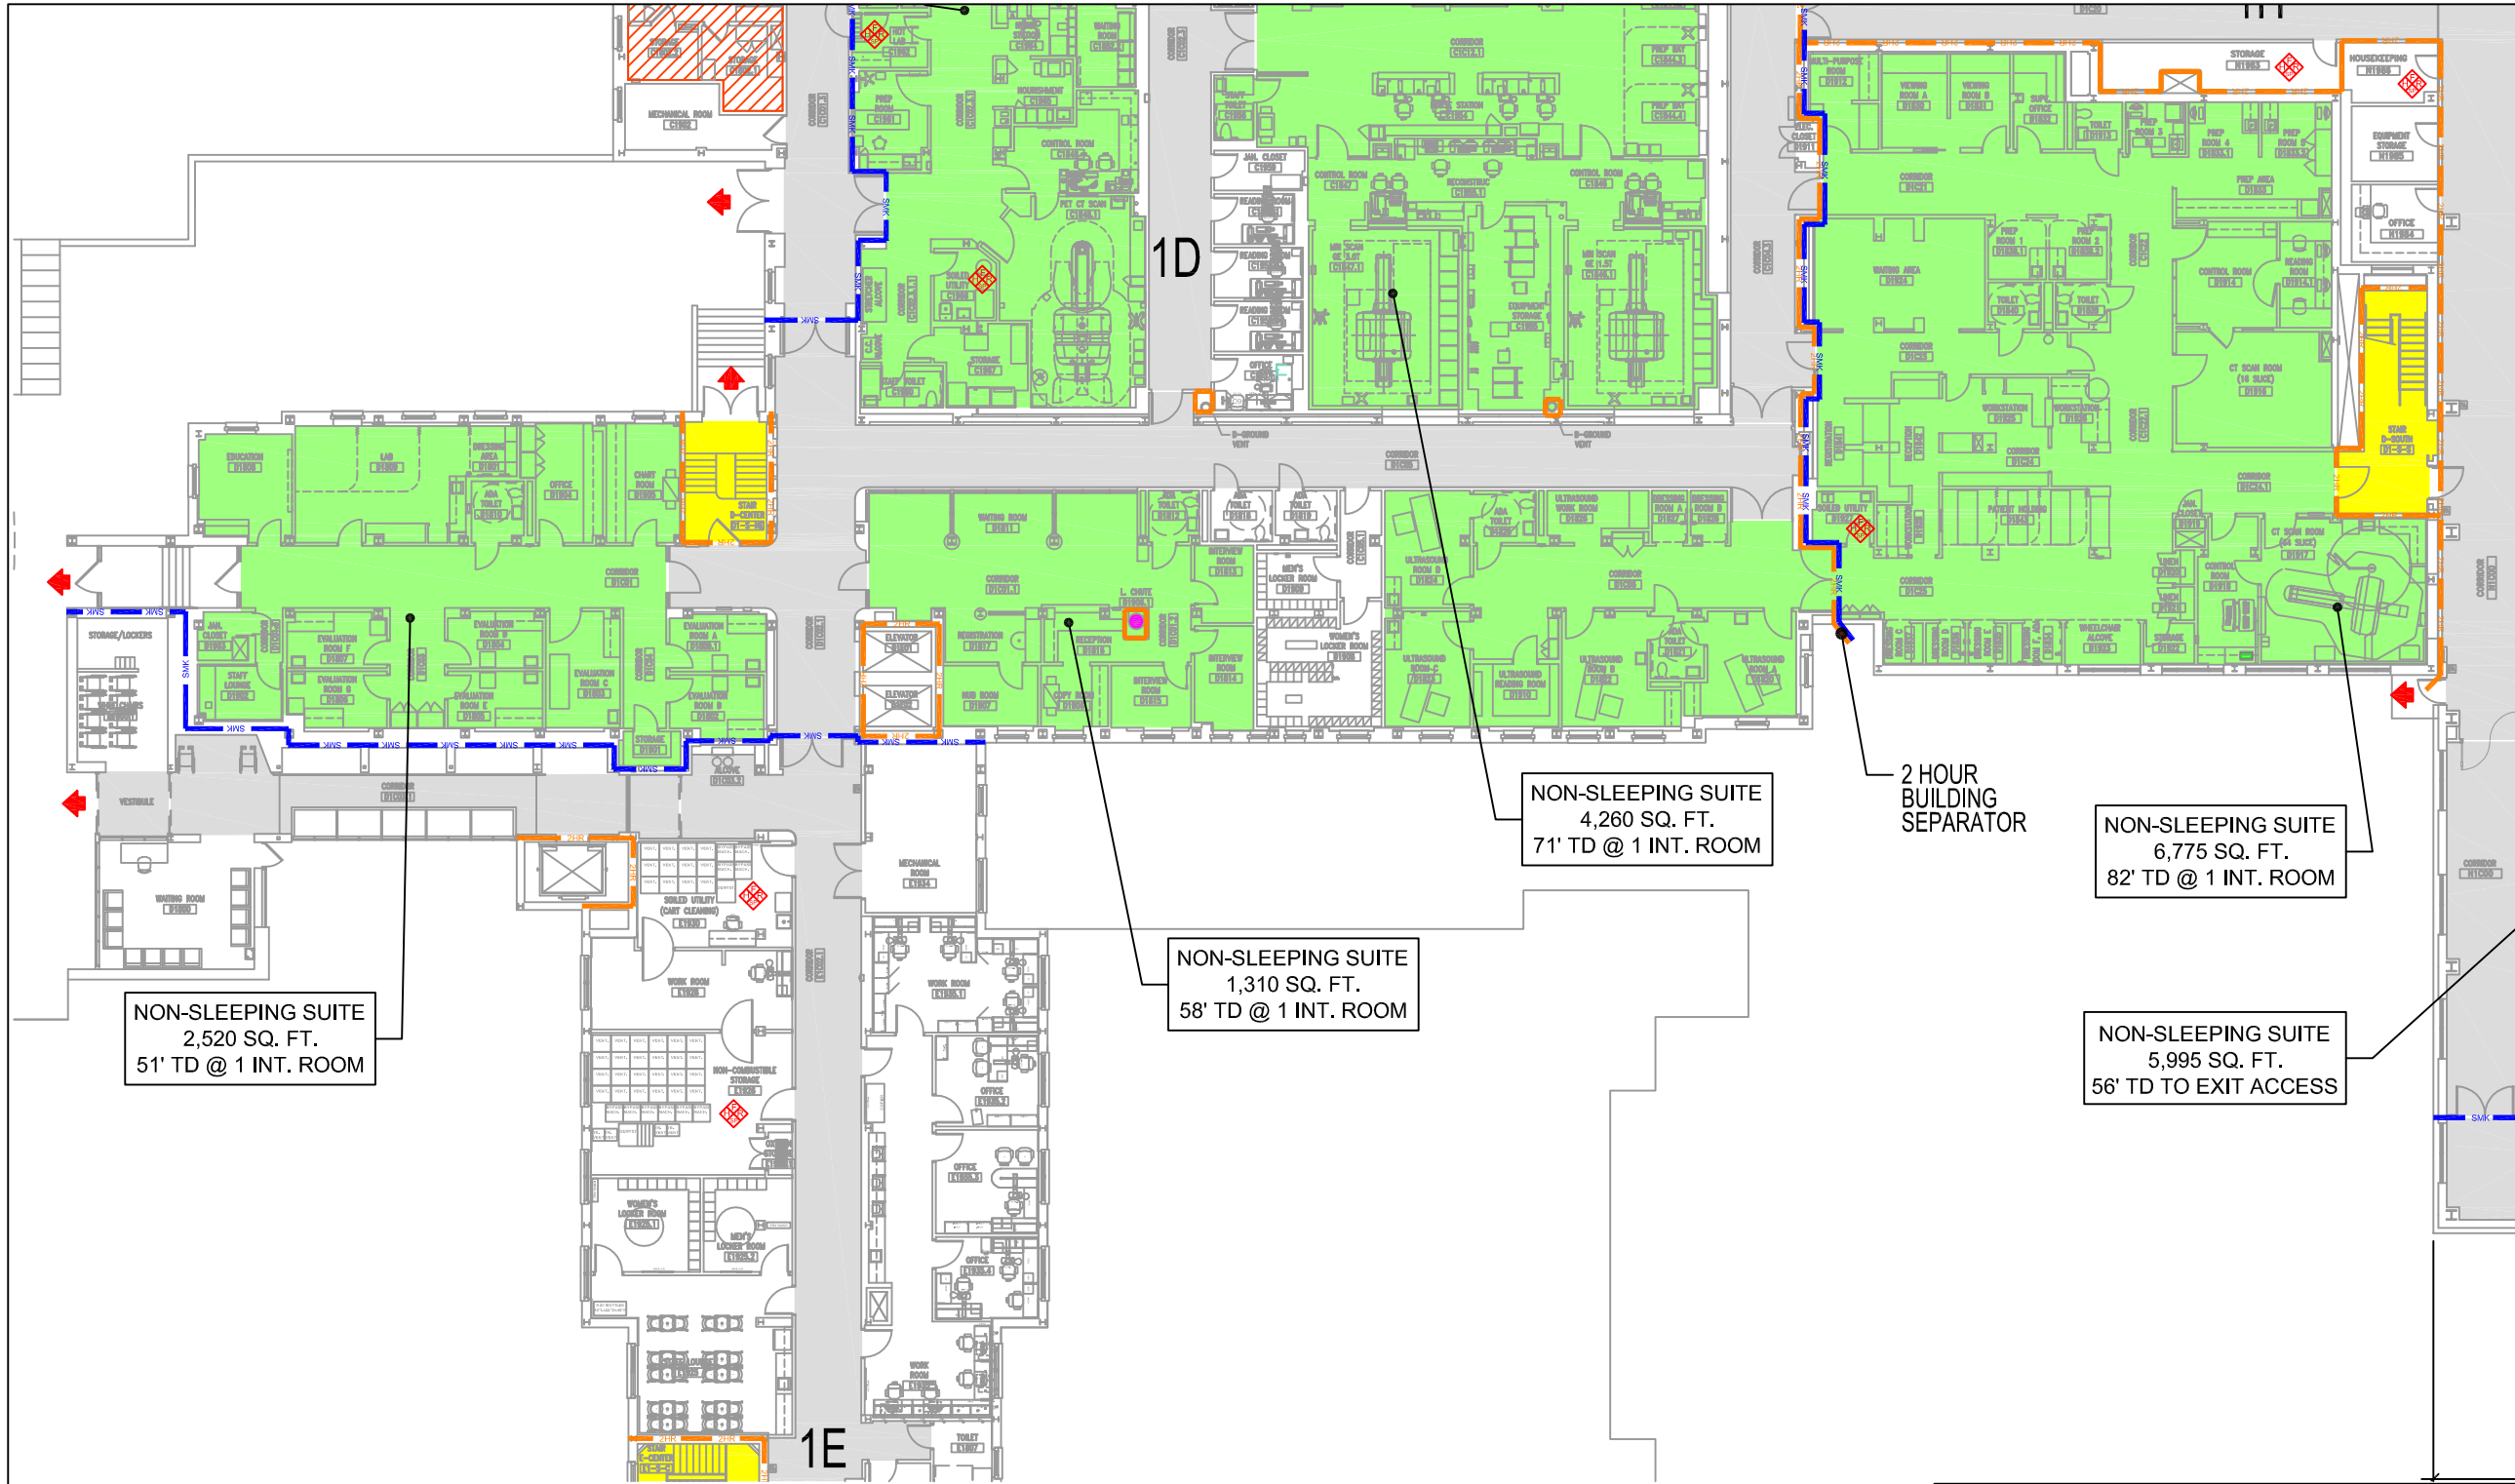

NON-SLEEPING SUITE  
2,520 SQ. FT.  
51' TD @ 1 INT. ROOM

NON-SLEEPING SUITE  
1,310 SQ. FT.  
58' TD @ 1 INT. ROOM

NON-SLEEPING SUITE  
4,260 SQ. FT.  
71' TD @ 1 INT. ROOM

2 HOUR BUILDING SEPARATOR

NON-SLEEPING SUITE  
6,775 SQ. FT.  
82' TD @ 1 INT. ROOM

NON-SLEEPING SUITE  
5,995 SQ. FT.  
56' TD TO EXIT ACCESS

FIRST FLOOR						
SMOKE COMPARTMENT	AREA SQ. FT.	OCCUPANT LOAD	SPRINKLERED	USE/ TYPE	TRAVEL DISTANCE TO SMOKE BARRIER	TRAVEL DISTANCE TO NEAREST EXIT
1A	15,525	65	FULLY SPRINKLERED	TREATMENT	184'	180'
1B	8,810	37	FULLY SPRINKLERED	TREATMENT	129'	107'
1C	15,280	64	FULLY SPRINKLERED	TREATMENT	91'	150'
1D	18,790	78	FULLY SPRINKLERED	TREATMENT	105'	146'
1E	14,965	125	FULLY SPRINKLERED	SLEEPING	101'	132'
1F	2,800	23	FULLY SPRINKLERED	SLEEPING	74'	75'
1G	7,040	59	FULLY SPRINKLERED	SLEEPING	146'	134'
1H	9,150	38	FULLY SPRINKLERED	TREATMENT	184'	95'
1I	15,370	64	FULLY SPRINKLERED	TREATMENT	117'	190'
1J	12,100	50	FULLY SPRINKLERED	TREATMENT	91'	130'
1K	12,485	52	FULLY SPRINKLERED	TREATMENT	69'	128'
1L	12,050	50	FULLY SPRINKLERED	TREATMENT	53'	159'
1M	14,745	123	FULLY SPRINKLERED	SLEEPING	174'	157'
1N	19,360	81	FULLY SPRINKLERED	TREATMENT	197'	184'
1O	12,325	51	FULLY SPRINKLERED	TREATMENT	64'	164'
1P	14,695	122	FULLY SPRINKLERED	SLEEPING	197'	139'
1Q	13,065	109	FULLY SPRINKLERED	SLEEPING	NA'	165'
TOTAL	218,545	1,191				

PROJECT:  
**YOUR FACILITY NAME HERE**  
TURNERSVILLE NJ

TITLE:  
**2012 LIFE SAFETY DRAWINGS FIRST FLOOR PLAN**

No.	REVISIONS	DATE

SCALE: N.T.S. DWG. No.:  
DATE: 1/1/12  
CHK. BY: JG DWG. BY: BDW  
**LS-1**

\* = PER NFPA 101, 2000 EDITION 19.3.7.1